



# Wiring

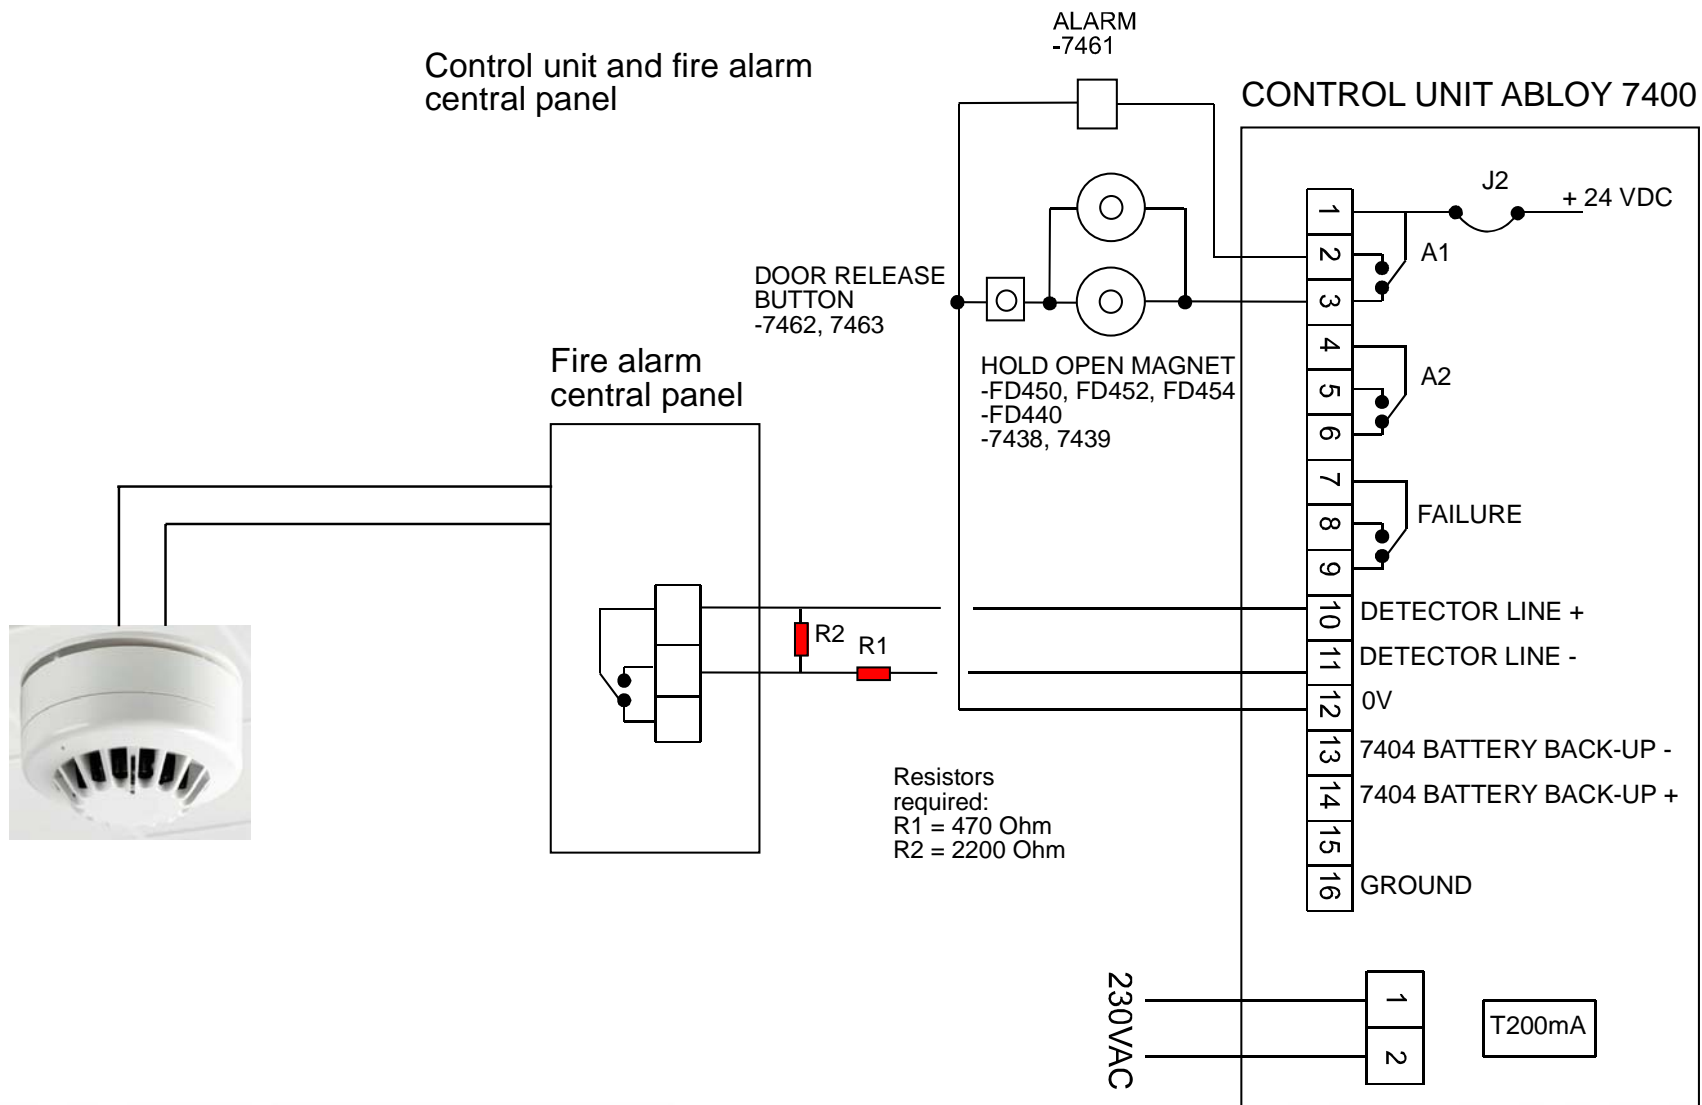

# Wiring


Relay included  
FD600 optical,  
FD601 ionization

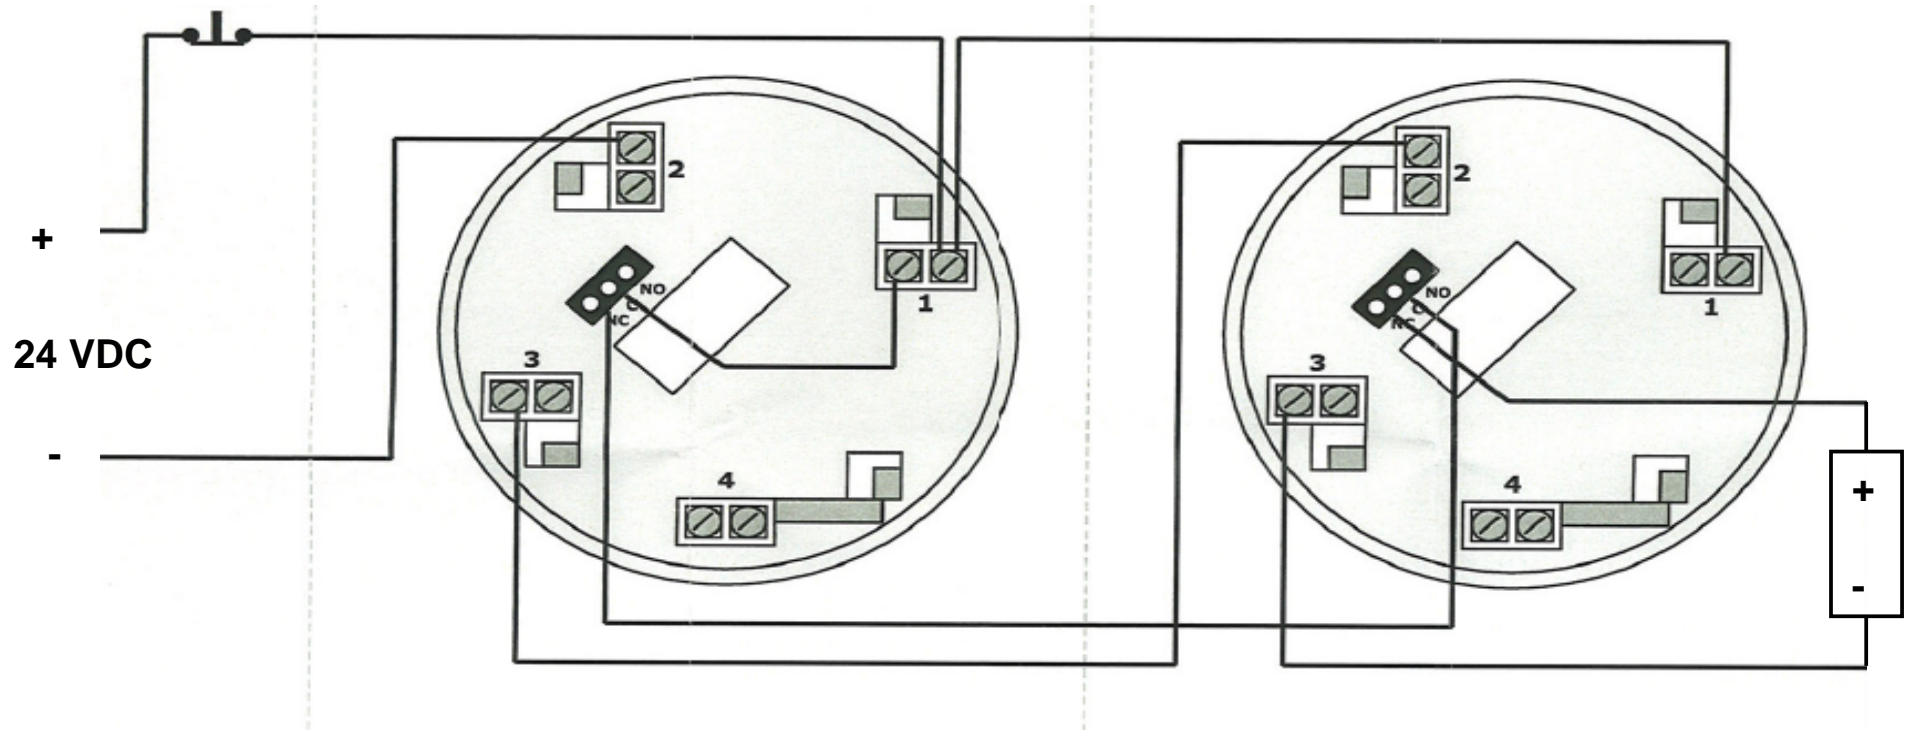

Electrical Hold open device  
or magnet

# Wiring

## CONTROL UNIT ABLOY 7400

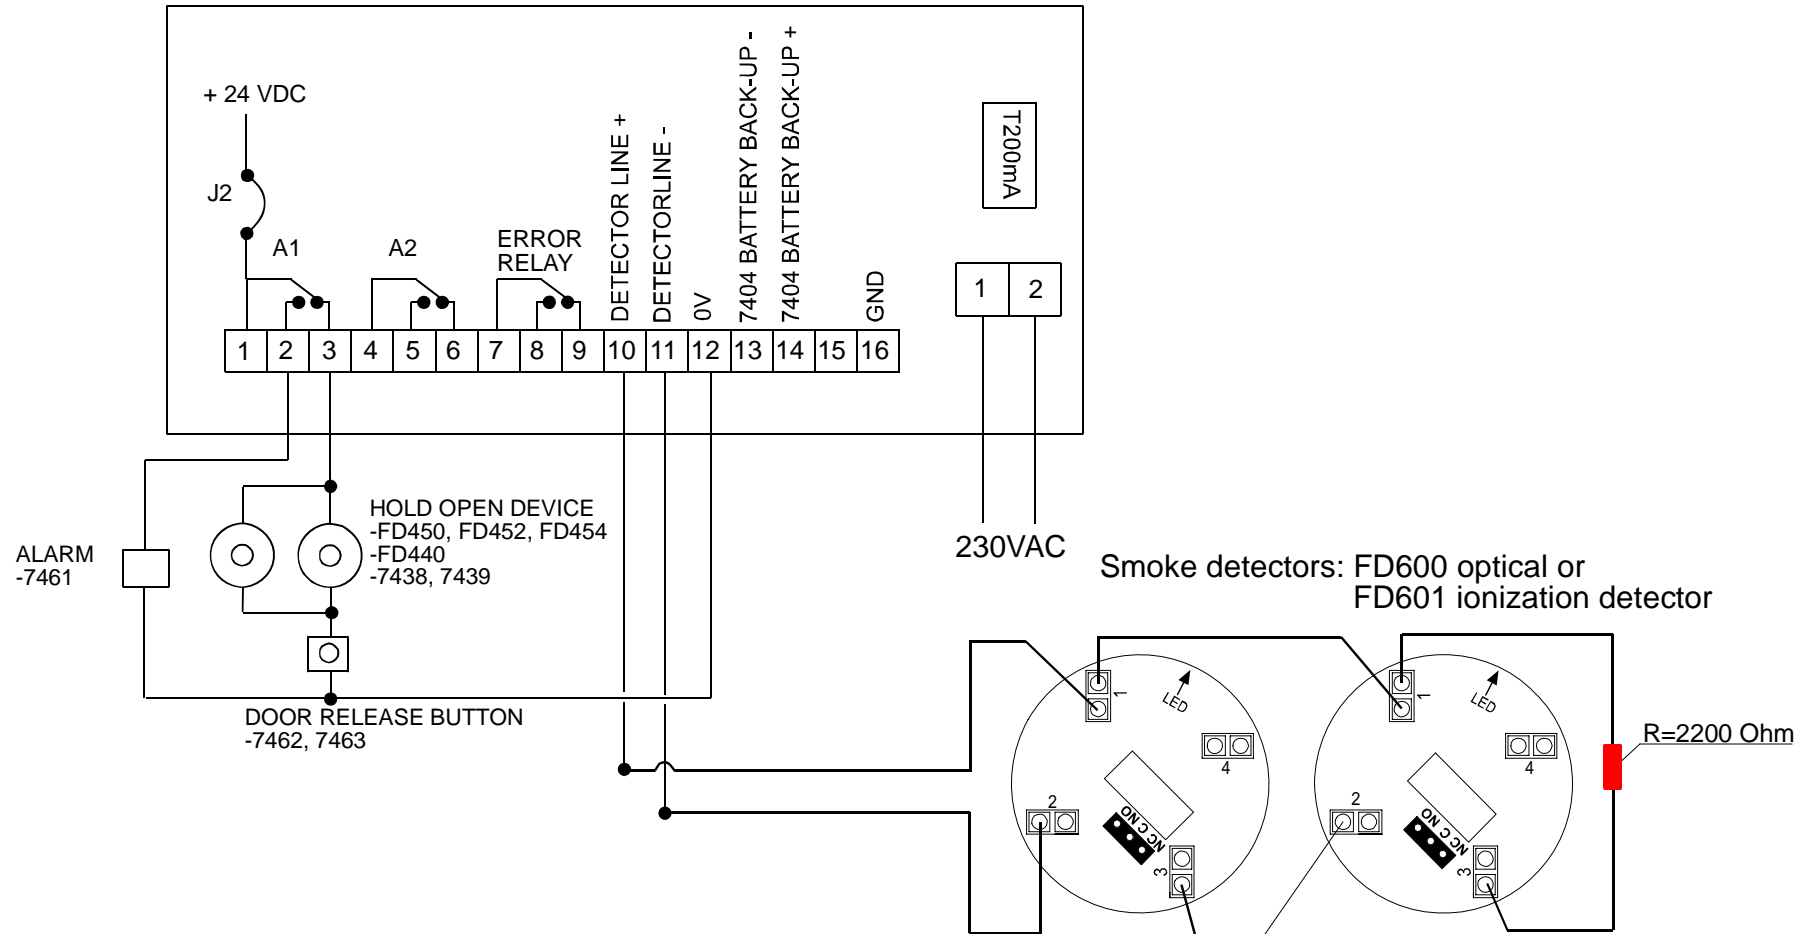

**ATTN!**

**Shift resistor from control unit to the last detector on the line, see wiring.**